
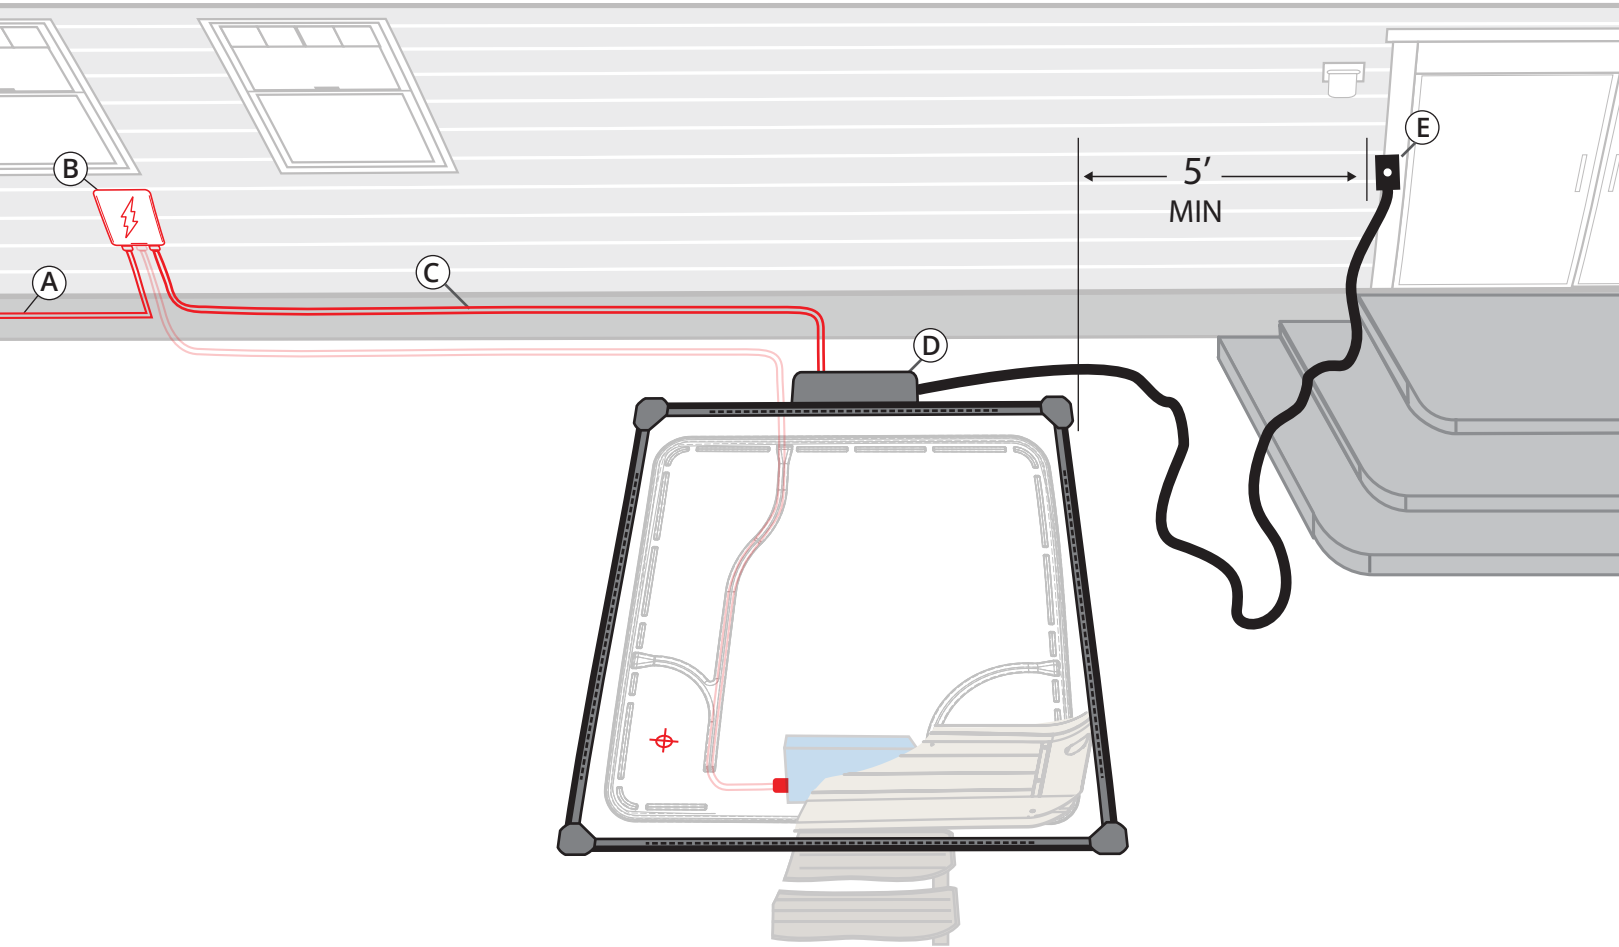


COVANA
STOCK INSTALLATION

STOCK INSTALLATION COVANA






The Covana requires a 15A power supply separate from the spa's power supply line.

COVANA TECHNICAL REQUIREMENTS

SERVICE	110v
AMPERAGE	15A
BREAKER TYPE	GFCI
WIRE TYPE	14ga

- (A) Supply Line
- (B) Spa Disconnect / Breaker Box
- (C) Wires from 15a breaker to covana
- (D) Covana Control Box
- (E) Surface Mount Control Key

STOCK INSTALLATION COVANA

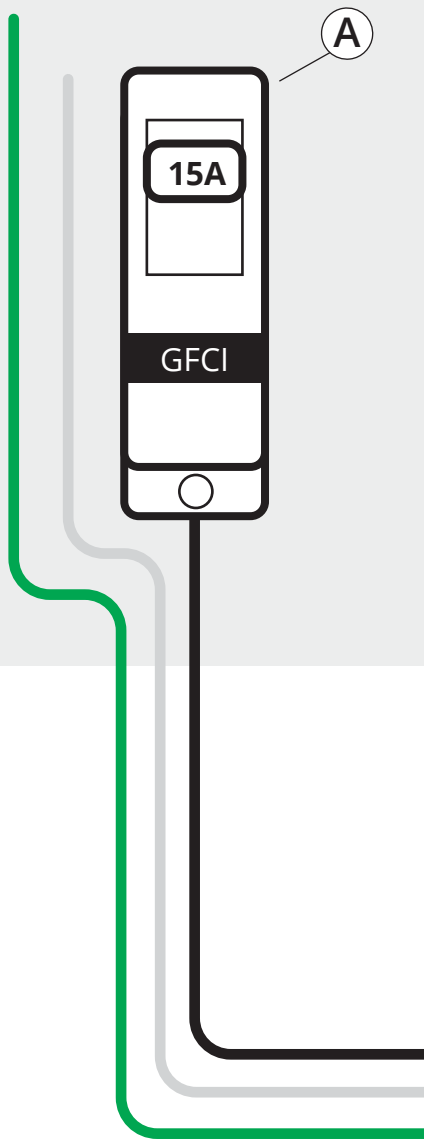

The Covana gazebo requires an independent power supply. Bullfrog Spas of Northern Utah does not provide electrical services. A certified electrician will need to install the supply line indicated by this diagram.



- Ⓐ 15A GFCI Breaker
- Ⓑ Single gang box for switch
- Ⓒ Double-throw switch. (Provided by Bullfrog).
- Ⓓ Covana control box (Provided by Bullfrog).

Ⓓ


COVANA

COVANA DIMENSIONS

Recommended pad size and dimensions for the Covana Oasis

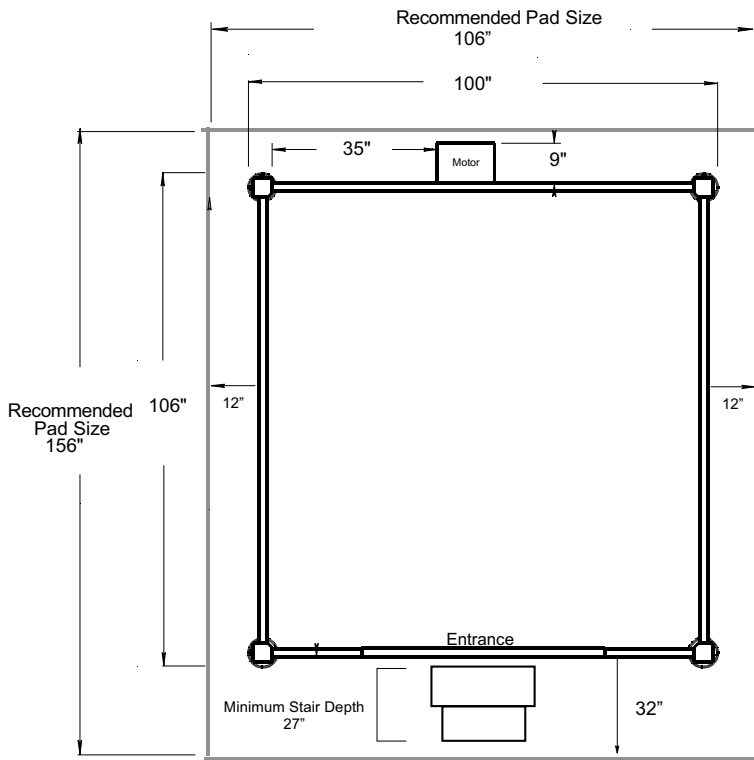

Covana Oasis Top View

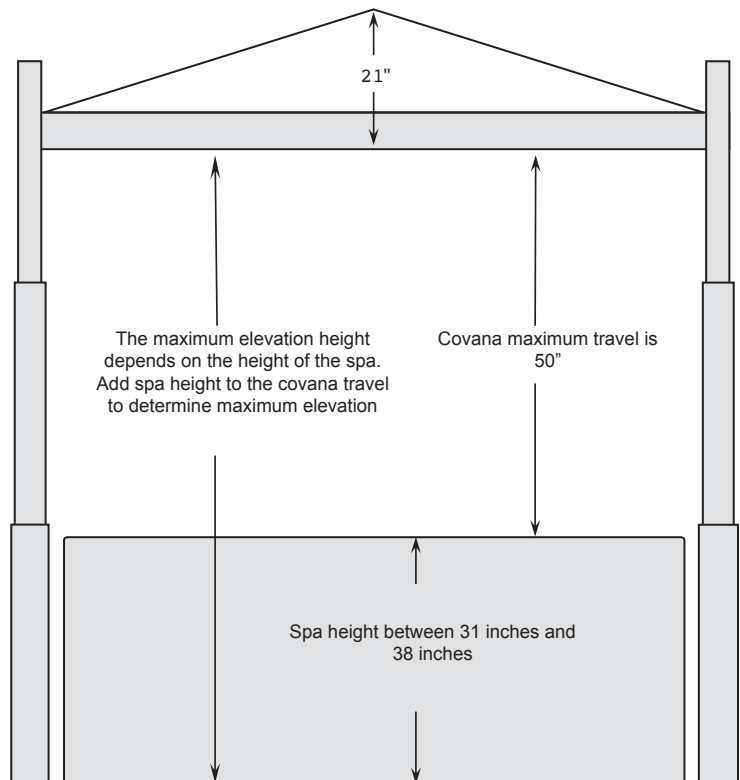

Covana Oasis Side View